


Recommended Commercial BoilerMate Installation - Six Tanks

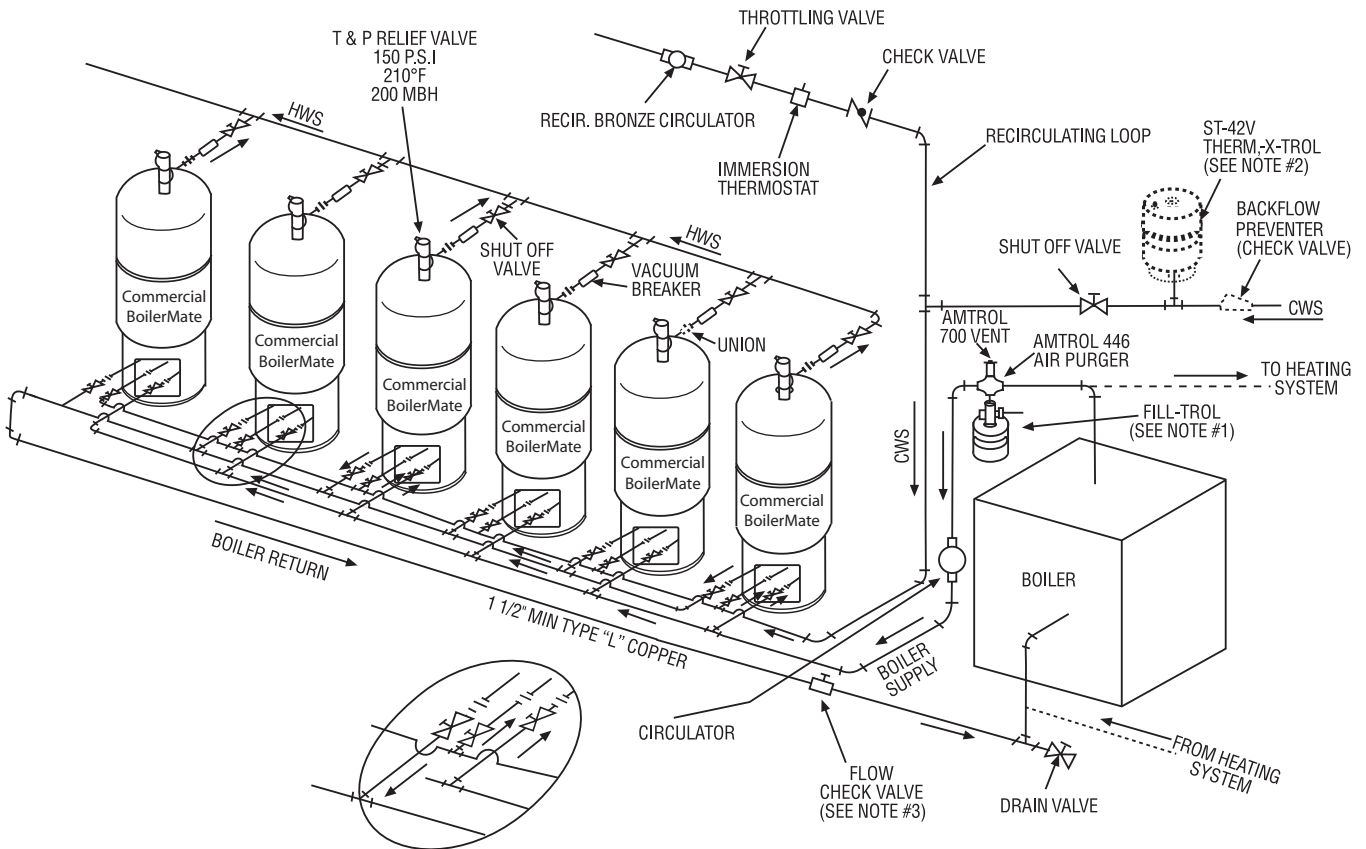

NOTES:

1. FILL-TROL MUST BE SIZED TO HANDLE A BOILER SYSTEM THERMAL EXPANSION. ON LARGE SYSTEMS, AN ADDITIONAL EXTROL MAY BE REQUIRED.
2. THERM-X-TROL IS REQUIRED WHEN THE DOMESTIC WATER SYSTEM HAS A BACKFLOW PREVENTION DEVICE OR CHECK VALVE ON THE INCOMING WATERLINE.
3. REQUIRED WHEN BOILER IS USED FOR BOTH SPACE HEATING AND DOMESTIC HOT WATER, (OR WHEN A FLOW CONTROL IS REQUIRED).